



... eine starke Verbindung

DECLARAÇÃO DE DESEMPENHO

DoP N.o: **MKT-540** - pt


- ✧ **Código de identificação único do produto-tipo:** Sistema de injeção VMH conexão vergalhão subsequente
- ✧ **Utilização(ões) prevista(s):** Sistema conexão vergalhão subsequente, ver Anexo B / Annex B
- ✧ **Fabricante:** MKT Metall-Kunststoff-Technik GmbH & Co.KG
Auf dem Immel 2
67685 Weilerbach
- ✧ **Sistema(s) de avaliação e verificação da regularidade do desempenho (AVCP):** 1
- ✧ **Documento de Avaliação Europeu** **EAD 330087-00-0601**
Avaliação Técnica Europeia : **ETA-17/0715, 18.07.2018**
Organismo de Avaliação Técnica: DIBt, Berlin
Organismo(s) notificado (s): NB 1343 – MPA, Darmstadt

✧ **Desempenho(s) declarado(s):**

| Características essenciais | Desempenho |
|--|---------------------|
| Resistência mecânica e estabilidade (BWR1) | |
| Resistências características para cargas estáticas e quase estáticas | Anexo/Annex C1 |
| Segurança contra incêndio (BWR2) | |
| Comportamento do fogo | Classe A1 |
| Resistência ao fogo | Anexo/Annex C2 – C3 |

O desempenho do produto identificado acima está em conformidade com o conjunto de desempenhos declarados. A presente declaração de desempenho é emitida, em conformidade com o Regulamento (UE) n.o 305/2011, sob a exclusiva responsabilidade do fabricante identificado acima.

Assinado por e em nome do fabricante por:


Stefan Weustenhagen
(Diretor-gerente)
Weilerbach, 18.07.2018

p.p. 
Dipl.-Ing. Detlef Bigalke
(Director de Desenvolvimento de Produto)



O original desta declaração de desempenho foi escrito em alemão. Em caso de desvios na tradução, a versão alemã é válida.

Specifications of intended use

Anchorage subject to:

| Rebar | Ø8 | Ø10 | Ø12 | Ø14 | Ø16 | Ø20 | Ø22 | Ø24 | Ø25 | Ø28 | Ø32 |
|-------------------------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Static or quasi static action | | | | | | | | | | | ✓ |
| Fire exposure | | | | | | | | | | | ✓ |

| Tension anchor ZA | M12 | M16 | M20 | M24 |
|-------------------------------|-----|-----|-----|-----|
| Static or quasi static action | | | ✓ | |
| Fire exposure | | | ✓ | |

Base material:

- Reinforced or unreinforced normal weight concrete acc. to EN 206-1:2000
- Strength classes C12/15 to C50/60 acc. to EN 206-1:2000
- Maximum chloride concrete of 0,40 % (CL 0,40) related to the cement content acc. to EN 206-1:2000
- Non-carbonated concrete

Note: In case of a carbonated surface of the existing concrete structure the carbonated layer shall be removed in the area of the post-installed rebar connection with a diameter of $\varnothing + 60$ mm prior to the installation of the new rebar. The depth of concrete to be removed shall correspond to at least the minimum concrete cover in accordance with EN 1992-1-1:2004+AC:2010.

The foregoing may be neglected if building components are new and not carbonated and if building components are in dry conditions.

Temperature range:

- - 40 °C to +80 °C (max. short term temperature +80 °C and max. long term temperature +50 °C)

Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (zinc plated steel, stainless steel or high corrosion resistant steel)
- Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if no particular aggressive conditions exist (stainless steel or high corrosion resistant steel)
- Structures subject to external atmospheric exposure and to permanently damp internal condition, if other particular aggressive conditions exist (high corrosion resistant steel)

Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used)

Injection System VHM for rebar connections

Intended use
Specifications of intended use

Annex B1

Specifications of intended use

Design:

- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored
- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work
- Anchorages are designed in accordance with EN 1992-1-1:2004+AC:2010, EN1992-1-2:2004+AC:2008 and Annex B3 and B4
- The actual position of the reinforcement in the existing structure shall be determined on the basis of the construction documentation and taken into account when designing

Installation:

- Dry or wet concrete
- Installation in water filled bore holes is not admissible
- Overhead installation admissible
- Hole drilling by hammer drill, vacuum drill or compressed air drill
- Check the position of the existing rebars (if the position of existing rebars is not known, it shall be determined using a rebar detector suitable for this purpose as well as on the basis of the construction documentation and then marked on the building component for the overlap joint)
- The joints for concreting must be roughened to at least such an extent that aggregate protrude
- The installation of post-installed rebar or tension anchor ZA shall be done only by suitable trained installer and under supervision on site; the conditions under which an installer may be considered as suitable trained and the conditions for supervision on site are up to the member states in which the installation is done
- Minimum concrete cover acc. to EN 1992-1-1:2004+AC:2010 must be observed

Injection System VHM for rebar connections


Intended use
Specifications of intended use

Annex B2

General construction rules for tension anchor ZA

- The length for the post-installed thread must not be added to the anchoring length
- The tension anchor ZA can only transfer forces towards the bar axis
- Tension forces must be transferred by an overlap joint into the present reinforcement of the member
- The transmission of shear forces must be ensured by additional measures, e.g. by shear cleats or anchors with an European Technical Assessment (ETA)
- In the anchor plate the holes for the tension anchors must be executed as elongated holes with axis in the direction of the shear force
- If the clear distance of overlapping bars is greater than $4\varnothing$, the lap length must be increased by a length equal to the clear space where it exceeds $4\varnothing$

Figure B1: Tension Anchor ZA

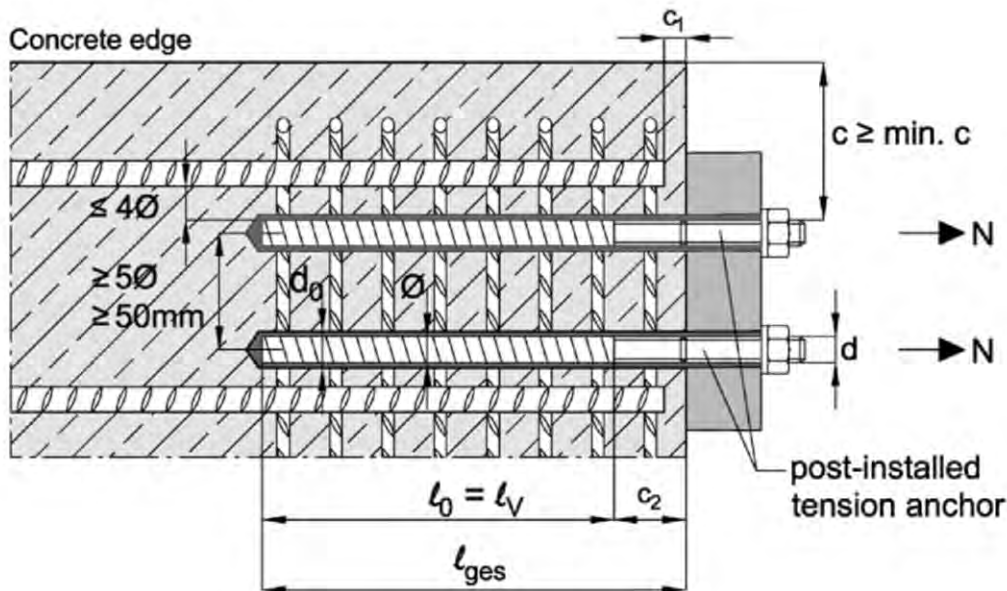

| | |
|------------------|---|
| c | concrete cover of tension anchor ZA |
| c ₁ | concrete cover at front end of cast-in-place rebar |
| c ₂ | Length of bonded thread |
| min c | minimum concrete cover according to Table B1 and EN 1992-1-1:2004+AC:2010 |
| Ø | diameter of tension anchor (rebar part) |
| d | diameter of tension anchor (threaded part) |
| l ₀ | lap length acc. to EN 1992-1-1:2004+AC:2010 |
| l _v | embedment depth $l_v \geq l_0 + c_1$ |
| l _{ges} | overall embedment depth $l_{ges} \geq l_0 + c_2$ |
| d ₀ | nominal drill bit diameter according to Annex B6, to Table B4 |

Injection System VHM for rebar connections


Intended use
General construction rules (Tension anchor ZA)

Annex B3

General construction rules for post-installed rebars

- The shear transfer between old and new concrete shall be designed acc. to EN 1992-1-1:2004+AC:2010
- Only tension forces in the axis of the rebar may be transmitted
- If the clear distance of overlapping bars is greater than $4\varnothing$, the lap length must be increased by a length equal to the clear space where it exceeds $4\varnothing$

Figure B2: Post-installed rebars

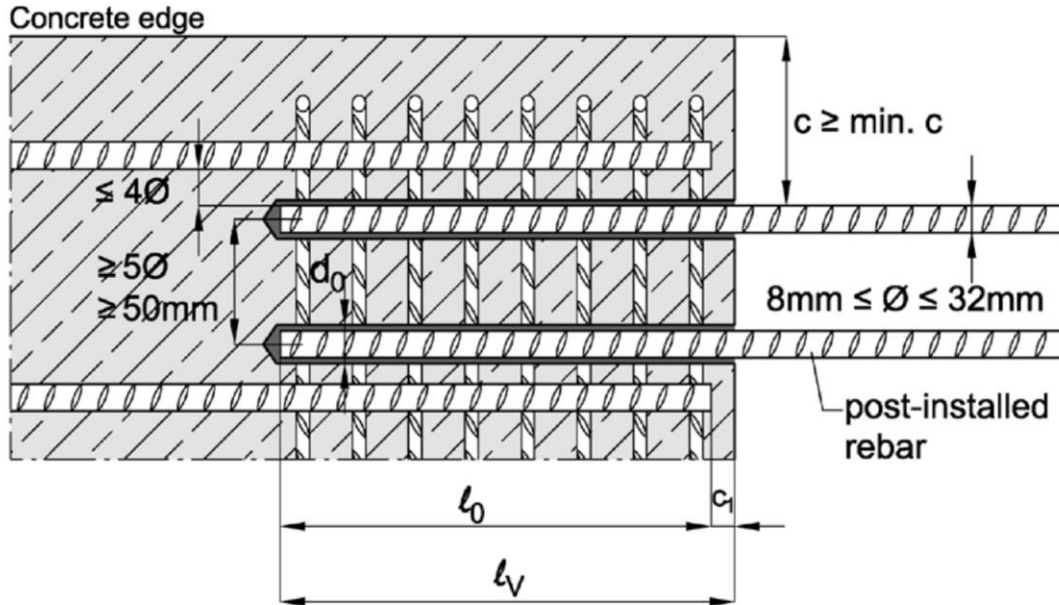

- c concrete cover of post-installed rebar
 c_1 concrete cover at front end of cast-in-place rebar
 $\min c$ minimum concrete cover according Table B1 and EN 1992-1-1:2004+AC:2010
 \varnothing diameter of tension anchor (rebar)
 l_0 lap length acc. to EN 1992-1-1:2004+AC:2010
 l_v embedment depth $l_v \geq l_0 + c_1$
 d_0 nominal drill bit diameter according to Annex B6, Table B4

Injection System VHM for rebar connections

Intended use
General construction rules (**post-installed rebar**)

Annex B4

Table B1: Minimum concrete cover min c¹⁾ of post-installed rebar and tension anchor ZA depending on drilling method



| Drilling method | Rod diameter | min c | |
|------------------------------------|--------------|-----------------------------------|-----------------------------------|
| | | (without drilling aid device) | (with drilling aid device) |
| Hammer drilling Vacuum drilling | < 25 mm | 30 mm + 0,06 l _v ≥ 2 Ø | 30 mm + 0,02 l _v ≥ 2 Ø |
| | ≥ 25 mm | 40 mm + 0,06 l _v ≥ 2 Ø | 40 mm + 0,02 l _v ≥ 2 Ø |
| Compressed air drilling | < 25 mm | 50 mm + 0,08 l _v | 50 mm + 0,02 l _v |
| | ≥ 25 mm | 60 mm + 0,08 l _v | 60 mm + 0,02 l _v |

¹⁾ See Annex B3 and B4; Minimum concrete cover acc. to EN 1992-1-1:2004+AC:2010 must be observed

Table B2: Dimensions and installation parameters of tension anchor ZA

| Anchor size | | | M12 | M16 | M20 | M24 | |
|------------------------------------|--------------------|--------------------|---------------------------------|-------|-------|-------|-------|
| Thread diameter | d | [mm] | 12 | 16 | 20 | 24 | |
| Rebar diameter | Ø | [mm] | 12 | 16 | 20 | 25 | |
| Cross section area (threaded part) | A _s | [mm ²] | 84 | 157 | 245 | 353 | |
| Width across nut flats | SW | [mm] | 19 | 24 | 30 | 36 | |
| Effective embedment depth | l _v | [mm] | according to static calculation | | | | |
| Length of bonded thread | steel, zinc plated | c ₂ | [mm] | ≥ 20 | ≥ 20 | ≥ 20 | ≥ 20 |
| | A4/HCR | | | ≥ 100 | ≥ 100 | ≥ 100 | ≥ 100 |
| Maximum installation torque | T _{inst} | [Nm] | 50 | 100 | 150 | 150 | |

Table B3: Working and curing time

| Bore hole temperature | Working time | Minimum curing time | |
|-----------------------|---------------|---------------------|--------------|
| | | dry concrete | wet concrete |
| - 5 °C to - 1 °C | 50 min | 5 h | 10 h |
| 0 °C to + 4 °C | 25 min | 3,5 h | 7 h |
| + 5 °C to + 9 °C | 15 min | 2 h | 4 h |
| + 10 °C to + 14 °C | 10 min | 1 h | 2 h |
| + 15 °C to + 19 °C | 6 min | 40 min | 80 min |
| + 20 °C to + 29 °C | 3 min | 30 min | 60 min |
| + 30 °C to + 40 °C | 2 min | 30 min | 60 min |
| Cartridge temperature | +5°C to +40°C | | |

Injection System VHM for rebar connections

Intended use

Minimum concrete cover / Installation parameters ZA / Working and curing time

Annex B5

Table B4: Drilling and cleaning

| Rebar Ø | Tension anchor ZA | Drill bit diameter d_0 | Brush diameter | |
|------------|----------------------|-----------------------------|----------------|---------------|
| | | | Brush- Ø | min. Brush- Ø |
| | | | d_b | $d_{b,min}$ |
| [mm] | [-] | [mm] | [mm] | [mm] |
| 8 | | 12 | 14 | 12,5 |
| 10 | | 14 | 16 | 14,5 |
| 12 | M12 | 16 | 18 | 16,5 |
| 14 | | 18 | 20 | 18,5 |
| 16 | M16 | 20 | 22 | 20,5 |
| 20 | M20 | 25 | 27 | 25,5 |
| 22 | | 28 | 30 | 28,5 |
| 24 | | 32 | 34 | 32,5 |
| 25 | M24 | 32 | 34 | 32,5 |
| 28 | | 35 | 37 | 35,5 |
| 32 | | 40 | 43 | 40,5 |

**Compressed air hose
(min. 6 bar) with air valve**



**Recommended compressed air tool
(min. 6 bar)**



Brush RB



Brush extension



SDS Plus Adapter



**Retaining washer
VM-IA**



Extension pipe



Static mixer



Injection System VHM for rebar connections


Intended use
Cleaning and installation tools

Annex B6

Table B5: Installation tools and max. embedment depth

| Rebar Ø | Tension anchor ZA | Drill bit diameter d ₀ | Retaining washer ¹⁾ | Cartridges: all formats | | | | Cartridge: side-by-side (825 ml) | | | |
|------------|-------------------------|---|-----------------------------------|----------------------------|-------------------|----------------------------|-------------------|-------------------------------------|-------------------|-----|-----------------------|
| | | | | Hand- or akku-tool | | Compressed air tool | | Compressed air tool | | | |
| | | | | l _{v,max} [cm] | Extension pipe | l _{v,max} [cm] | Extension pipe | l _{v,max} [cm] | Extension pipe | | |
| 8 | | 12 | - | 70 | VM-XE 10 | 80 | VM-XE 10 | 80 | VM-XE 10 | | |
| 10 | | 14 | VM-IA 14 | | | 100 | | 100 | | 100 | |
| 12 | M12 | 16 | VM-IA 16 | | | | | 120 | | 120 | |
| 14 | | 18 | VM-IA 18 | | | 50 | | VM-XE 10 VM-XLE 16 | | 70 | VM-XE 10 VM-XLE 16 |
| 16 | M16 | 20 | VM-IA 20 | 160 | | | | | | | |
| 20 | M20 | 25 | VM-IA 25 | 50 | 200 | | 200 | | | | |
| 22 | | 28 | VM-IA 28 | | | | | | | | |
| 24 | | 32 | VM-IA 32 | | | | | | | | |
| 25 | M24 | 32 | VM-IA 32 | | | | | | | | |
| 28 | | 35 | VM-IA 35 | | | | | | | | |
| 32 | | 40 | VM-IA 40 | | | | | | | | |

¹⁾ For horizontal or overhead installation as well as for drill holes deeper than 240mm

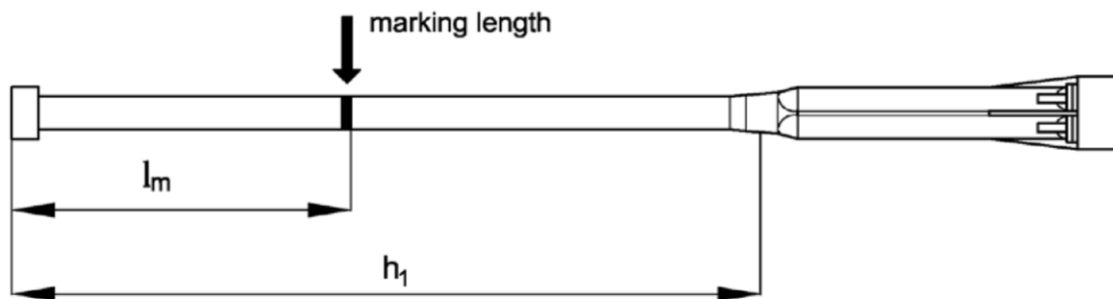

On the static mixer and the extension pipe the mortar filling mark l_m and the drill hole depth h_1 must be marked with an adhesive tape or text marker. Rough estimate: $l_m = \frac{1}{3} \cdot h_1$

Fill in the mortar as long until the filling mark l_m will be visible.

Optimal mortar volume: $l_m = h_1 * (1,2 * \frac{\phi^2}{d_0^2} - 0,2)$ [mm]

- l_m Length from the end of the retaining washer to the mark on the mixer extension
- h_1 drill hole depth = embedment depth l_v resp. l_{ges})
- Ø rebar diameter
- d_0 nominal drill bit diameter

Injection System VHM for rebar connections

Intended use

Installation tools, max. embedment depth, marking of extension pipe

Annex B7

Table B6: Dispensing tools

| Cartridge | | Hand tool | | Pneumatic tool |
|--------------|------------------|-------------------------|----------------------|--------------------------|
| Type | Size | | | |
| coaxial | 150, 280, 333 ml | e.g.: VM-P 330 | | e.g.: VM-P 345 Pneumatic |
| | 380 to 420 ml | e.g.: VM-P 380 Standard | e.g.: VM-P 380 Profi | e.g.: VM-P 380 Pneumatic |
| side-by-side | 235, 345 ml | e.g.: VM-P 345 Standard | e.g.: VM-P 345 Profi | e.g.: VM-P 345 Pneumatic |
| | 825 ml | - | - | e.g.: VM-P 825 Pneumatic |

All cartridges can also be extruded by battery tool (e.g. VM-P Akku)

Injection System VHM for rebar connections

Intended use
Dispensing tools

Annex B8

Installation instructions

Bore hole drilling


1.



Drill hole by hammer drilling, vacuum drilling or compressed air drilling (with drill bit diameter according to Annex B7 and selected embedment depth). In case of aborted holes, the bore holes must be filled with mortar.

Cleaning


2a.

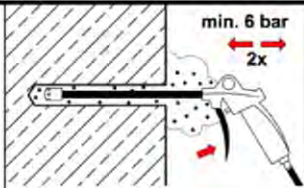

Starting from the bottom or back of the bore hole, blow out the hole with compressed air (min. 6 bar) (Annex B6) a minimum of **two** times until return air stream is free of noticeable dust. If the bore hole ground is not reached, an extension must be used.


2.

2b.

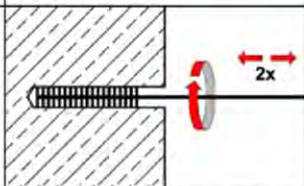

Brush the hole with an appropriate sized wire brush $\geq d_{b,min}$ (Table B4, check minimum brush diameter $d_{b,min}$) a minimum of **two** times with rotary motion. If the bore hole ground is not reached, a brush extension must be used.

2c.

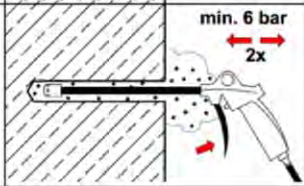

Starting from the bottom or back of the bore hole, blow out the hole with compressed air (min. 6 bar) again a minimum of **two** times until return air stream is free of noticeable dust. If the bore hole ground is not reached, an extension must be used.

Injection System VHM for rebar connections








Intended use

Installation instruction
Bore hole drilling and cleaning

Annex B9

Installation instruction (continuation)

Preparing and injection into borehole

| | | |
|----|---|---|
| 5 |  | Mark the position of the embedment depth l_v on the rebar. |
| 6 |  | Check drill hole depth by inserting rebar or anchor rod into the empty hole. |
| 7 |  | Prepare cartridge with static mixer (if necessary with extension pipe and retaining washer). Attach the supplied static-mixing nozzle to the cartridge and load the cartridge into the correct dispensing tool (Table B6). For every working interruption longer than the recommended working time (Table B3) as well as for new cartridges, a new static-mixer shall be used. |
| 7a |  | When extension pipe VM-XLE 16 is used, the tip of the mixer has to be cut off at position „X“. |
| 8 |  | Prior to applying, discard mortar (forerun) until the mortar shows a consistent grey colour, but at least three full strokes. Never use this mortar! |
| 9 |  | Fill in injection mortar from the bottom of the clean borehole approx 2/3 air bubble free. Slowly moving the static mixer out of the borehole prevents the formation of air inclusions. For embedment larger than 190mm an extension pipe (Annex B6) must be used. Observe the working- and curing time given in table B3. |
| 10 |  | For overhead and horizontal installation and embedment larger than 240mm a retaining washer shall be used. Observe the working- and curing time given in table B3. |

Injection System VHM for rebar connections





Intended use

Installation instruction (continuation)
Preparing and injection into the borehole

Annex B10

Installation instruction (continuation)

Installation of rebar or tension anchor

| | | |
|----|---|--|
| 11 |  | <p>Immediately insert the rebar or tension anchor into the hole while turning slightly until the embedment depth is reached. The bar shall be free of dirt, grease and oil.</p> |
| 12 |  | <p>Excess injection mortar must exceed from the borehole, the annular gap shall be filled completely with mortar. If no mortar exceeds, these requirements are not maintained and the application has to be renewed. For overhead installation fix embedment part (e.g. wedges).</p> |
| 13 |  | <p>Ensure the curing time of the injection mortar according to table B3. Attention: the working time may vary due to different underground temperatures (Table B3). Do not move or load the anchor or rebar until curing time.</p> |
| 14 |  | <p>After the curing time (Table B3) the threaded rod or reinforcing bar can be load.</p> |

Injection System VHM for rebar connections

Intended use

Installation instruction (continuation)
Installation of rebar or tension anchor

Annex B11

Minimum anchorage length and minimum lap length

The minimum anchorage length $\ell_{b,min}$ and the minimum lap length $\ell_{0,min}$ according to EN 1992-1-1:2004+AC:2010 ($\ell_{b,min}$ acc. to Eq. 8.6 and Eq. 8.7 and $\ell_{0,min}$ acc. to Eq. 8.11) shall be multiplied by the amplification factor α_{lb} acc. to Table C1.

Table C1: Amplification factor α_{lb} depending on concrete strength class and drilling method

| Concrete strength class | Drilling method | Rod diameter | Amplification factor α_{lb} [-] |
|-------------------------|---|-------------------------------|--|
| C12/15 to C50/60 | hammer drilling vacuum drilling compressed air drilling | Ø8 to Ø32 ZA-M12 to ZA-M24 | 1,0 |

Table C2: Reduction factor k_b for all drilling methods

| Rod diameter | | Concrete strength class | | | | | | | | |
|-------------------------------|-----------|-------------------------|--------|--------|--------|--------|--------|--------|--------|--------|
| | | C12/15 | C16/20 | C20/25 | C25/30 | C30/37 | C35/45 | C40/50 | C45/55 | C50/60 |
| Ø8 to Ø32 ZA-M12 to ZA-M24 | k_b [-] | 1,0 | | | | | | | | |

Table C3: Design values of the ultimate bond stress $f_{bd,PIR}$ in N/mm² for all drilling methods and for good bond conditions

$$f_{bd,PIR} = k_b \cdot f_{bd}$$

with

f_{bd} : Design value of the ultimate bond stress in N/mm² considering the concrete strength classes and the rebar diameter according to EN 1992-1-1:2004+AC:2010 (for all other bond conditions multiply the values by 0,7)

k_b : Reduction factor according to Table C2

| Rod diameter | | Concrete strength class | | | | | | | | |
|-------------------------------|-----------------------------------|-------------------------|--------|--------|--------|--------|--------|--------|--------|--------|
| | | C12/15 | C16/20 | C20/25 | C25/30 | C30/37 | C35/45 | C40/50 | C45/55 | C50/60 |
| Ø8 to Ø32 ZA-M12 to ZA-M24 | $f_{bd,PIR}$ [N/mm ²] | 1,6 | 2,0 | 2,3 | 2,7 | 3,0 | 3,4 | 3,7 | 4,0 | 4,3 |

Injection System VHM for rebar connections

Performances

Amplification factor α_{lb}

Design values of ultimate bond resistance $f_{bd,PIR}$

Annex C1

Design value of ultimate bond stress $f_{bd,fi}$ under fire exposure for concrete classes C12/15 to C50/60 (all drilling methods):

The design value of ultimate bond stress $f_{bd,fi}$ under fire exposure will be calculated by the following equation:

$$f_{bd,fi} = k_{fi}(\theta) \cdot f_{bd,PIR} \cdot \gamma_c / \gamma_{M,fi}$$


$$\text{with: } \theta \leq 364^\circ\text{C: } k_{fi}(\theta) = 30,34 \cdot \theta^{(\theta^*-0,011)} / (f_{bd,PIR} \cdot 4,3) \leq 1,0$$

$$\theta > 364^\circ\text{C: } k_{fi}(\theta) = 0$$

| | |
|------------------|--|
| $f_{bd,fi}$ | design value of ultimate bond stress in case of fire in N/mm ² |
| θ | Temperature in °C in the mortar layer |
| $k_{fi}(\theta)$ | Reduction factor under fire exposure |
| $f_{bd,PIR}$ | Design value of the ultimate bond stress in N/mm ² in cold condition according to Table C2 considering concrete class, rebar diameter, drilling method and the bond conditions according to EN 1992-1-1:2004+AC:2010. |
| γ_c | partial factor acc. to EN 1992-1-1:2004+AC:2010 |
| $\gamma_{M,fi}$ | partial factor acc. to EN 1992-1-2:2004+AC:2008 |

For evidence under fire exposure the anchorage length shall be calculated according to EN 1992-1-1:2004+AC:2010 Equation 8.3 using the temperature-dependent ultimate bond stress $f_{bd,fi}$.

Figure C1: Example graph of reduction factor $k_{fi}(\theta)$
Concrete strength class C20/25 for good bond conditions

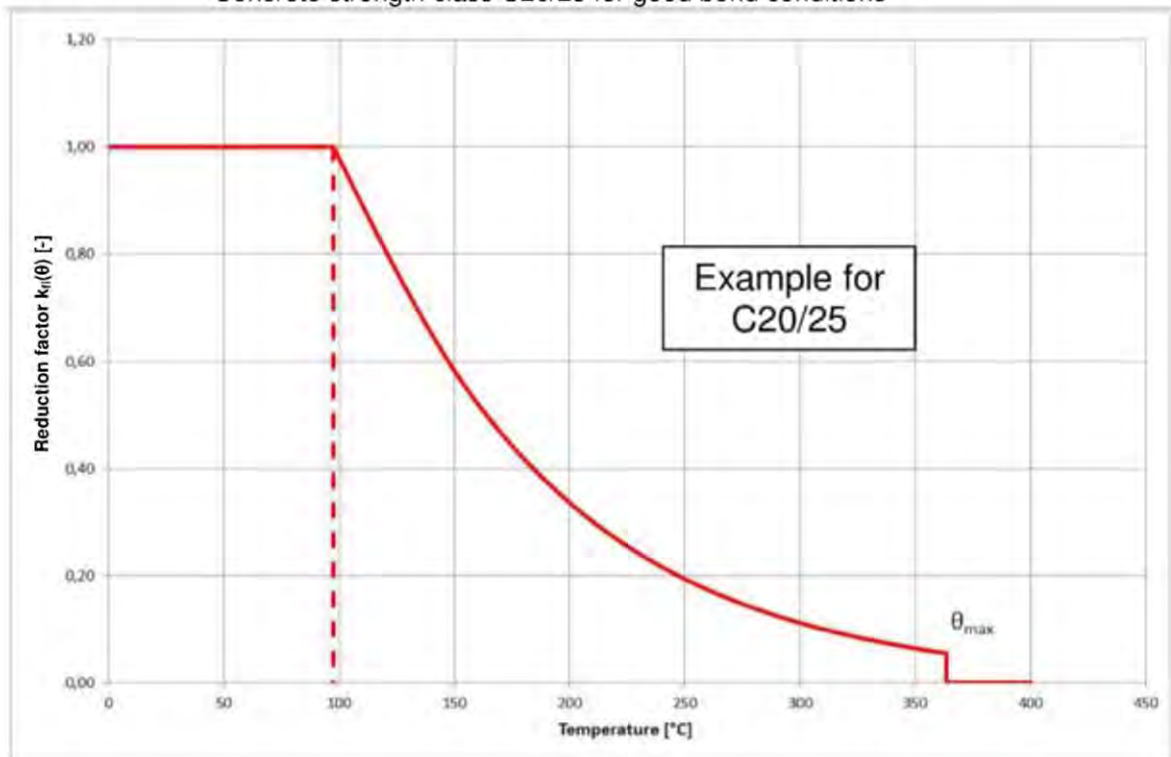

Injection System VHM for rebar connections

Performances

Design value of ultimate bond stress $f_{bd,fi}$ under fire exposure for rebar

Annex C2

Table C4: Characteristic tension strength in case of fire for tension anchor ZA,
concrete strength class C12/15 to C50/60, acc. to Technical Report TR 020

| Tension anchor ZA | | M12 | M16 | M20 | M24 |
|---------------------------------|------|---|-----|-----|-----|
| Steel failure | | | | | |
| Steel, zinc plated | | | | | |
| Characteristic tension strength | R30 | $\sigma_{Rk,s,fi}$ [N/mm ²] | 20 | | |
| | R60 | | 15 | | |
| | R90 | | 13 | | |
| | R120 | | 10 | | |
| Stainless steel A4, HCR | | | | | |
| Characteristic tension strength | R30 | $\sigma_{Rk,s,fi}$ [N/mm ²] | 30 | | |
| | R60 | | 25 | | |
| | R90 | | 20 | | |
| | R120 | | 16 | | |

Design value of the tension strength $\sigma_{Rd,s,fi}$ under fire exposure for tension anchor ZA

The design value of the steel strength $\sigma_{Rd,s,fi}$ under fire exposure will be calculated by the following equation:

$$\sigma_{Rd,s,fi} = \sigma_{Rk,s,fi} / \gamma_{M,fi}$$

with:

$\sigma_{Rk,s,fi}$ characteristic steel strength acc. to Table C4

$\gamma_{M,fi}$ partial factor under fire exposure acc. to EN 1992-1-2:2004+AC:2008

Injection System VHM for rebar connections

Performances

Steel strength for tension anchor ZA under fire exposure

Annex C3